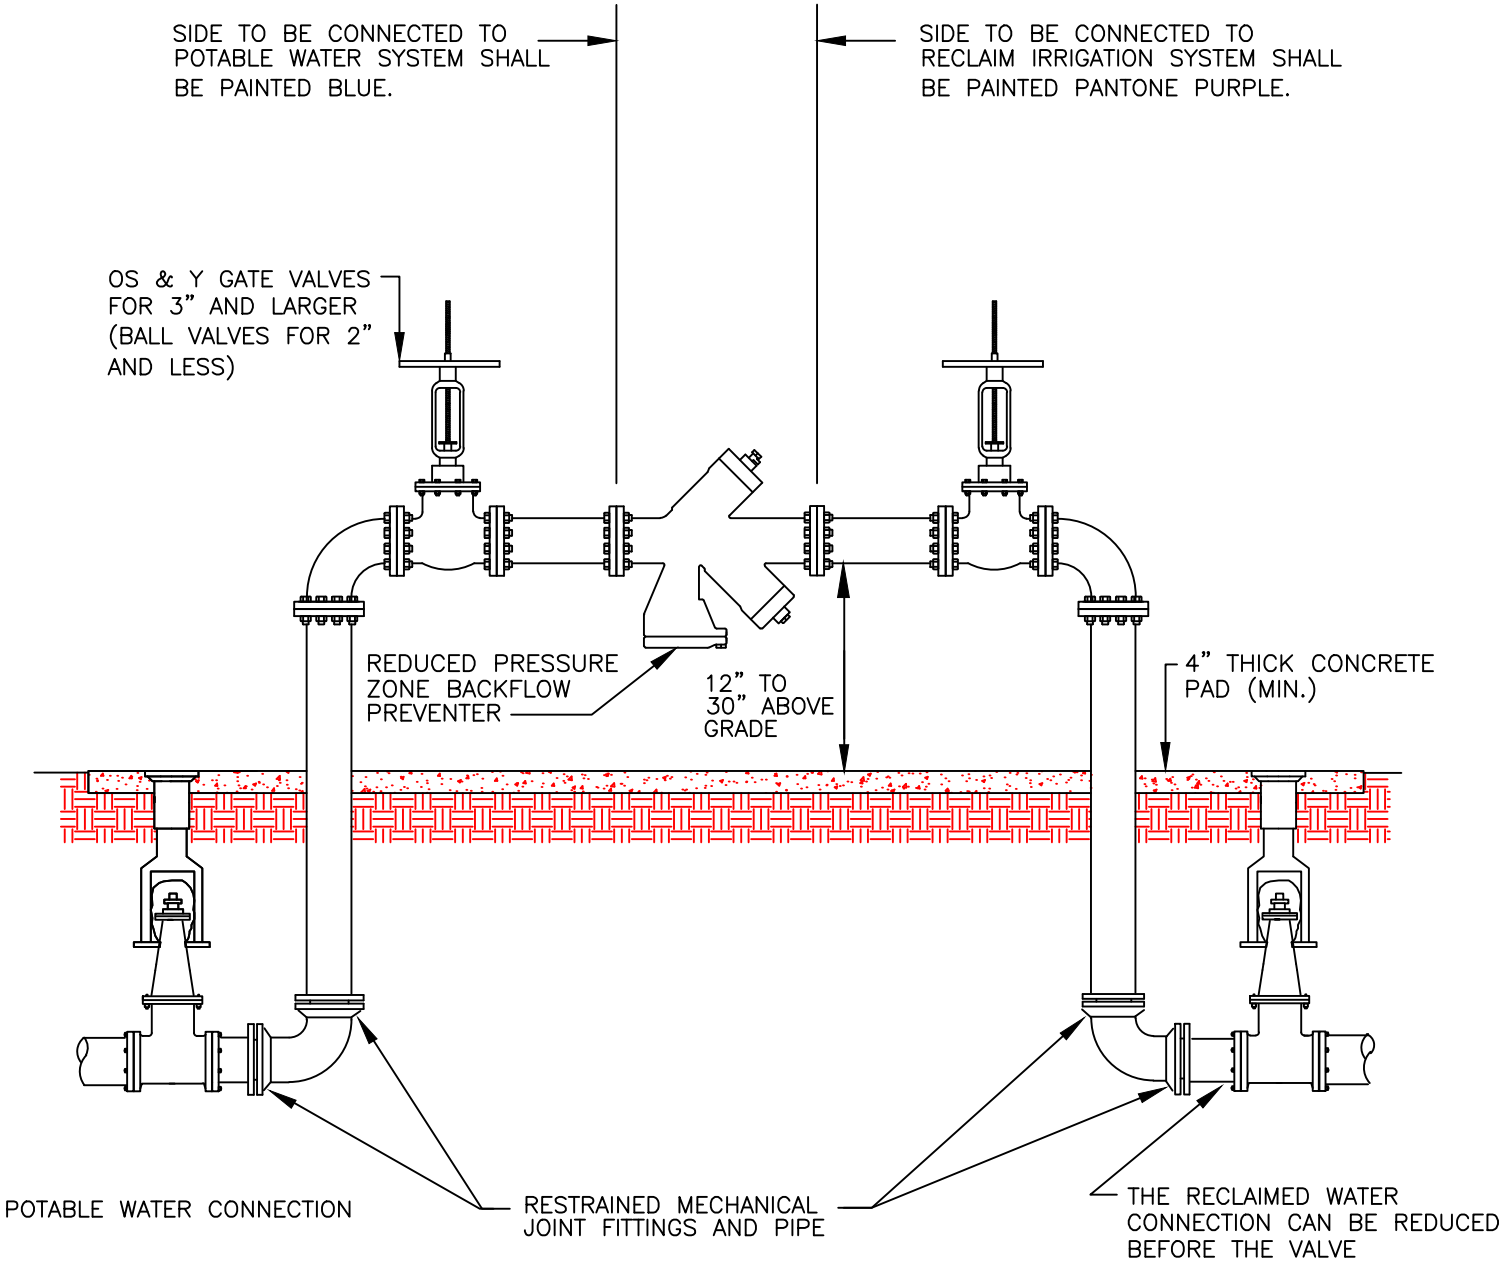

WHEN RECLAIM BECOMES AVALIABLE THE RPZ BACKFLOW PREVENTER SHALL BE REMOVED SO THERE IS NO PHYSICAL CONNECTION BETWEEN THE POTABLE WATER AND RECLAIM MAINS.

POTABLE WATER – RECLAIMED WATER JUMPER

SEM. CO OCT 2012
402